


TCVGH Temperature Log

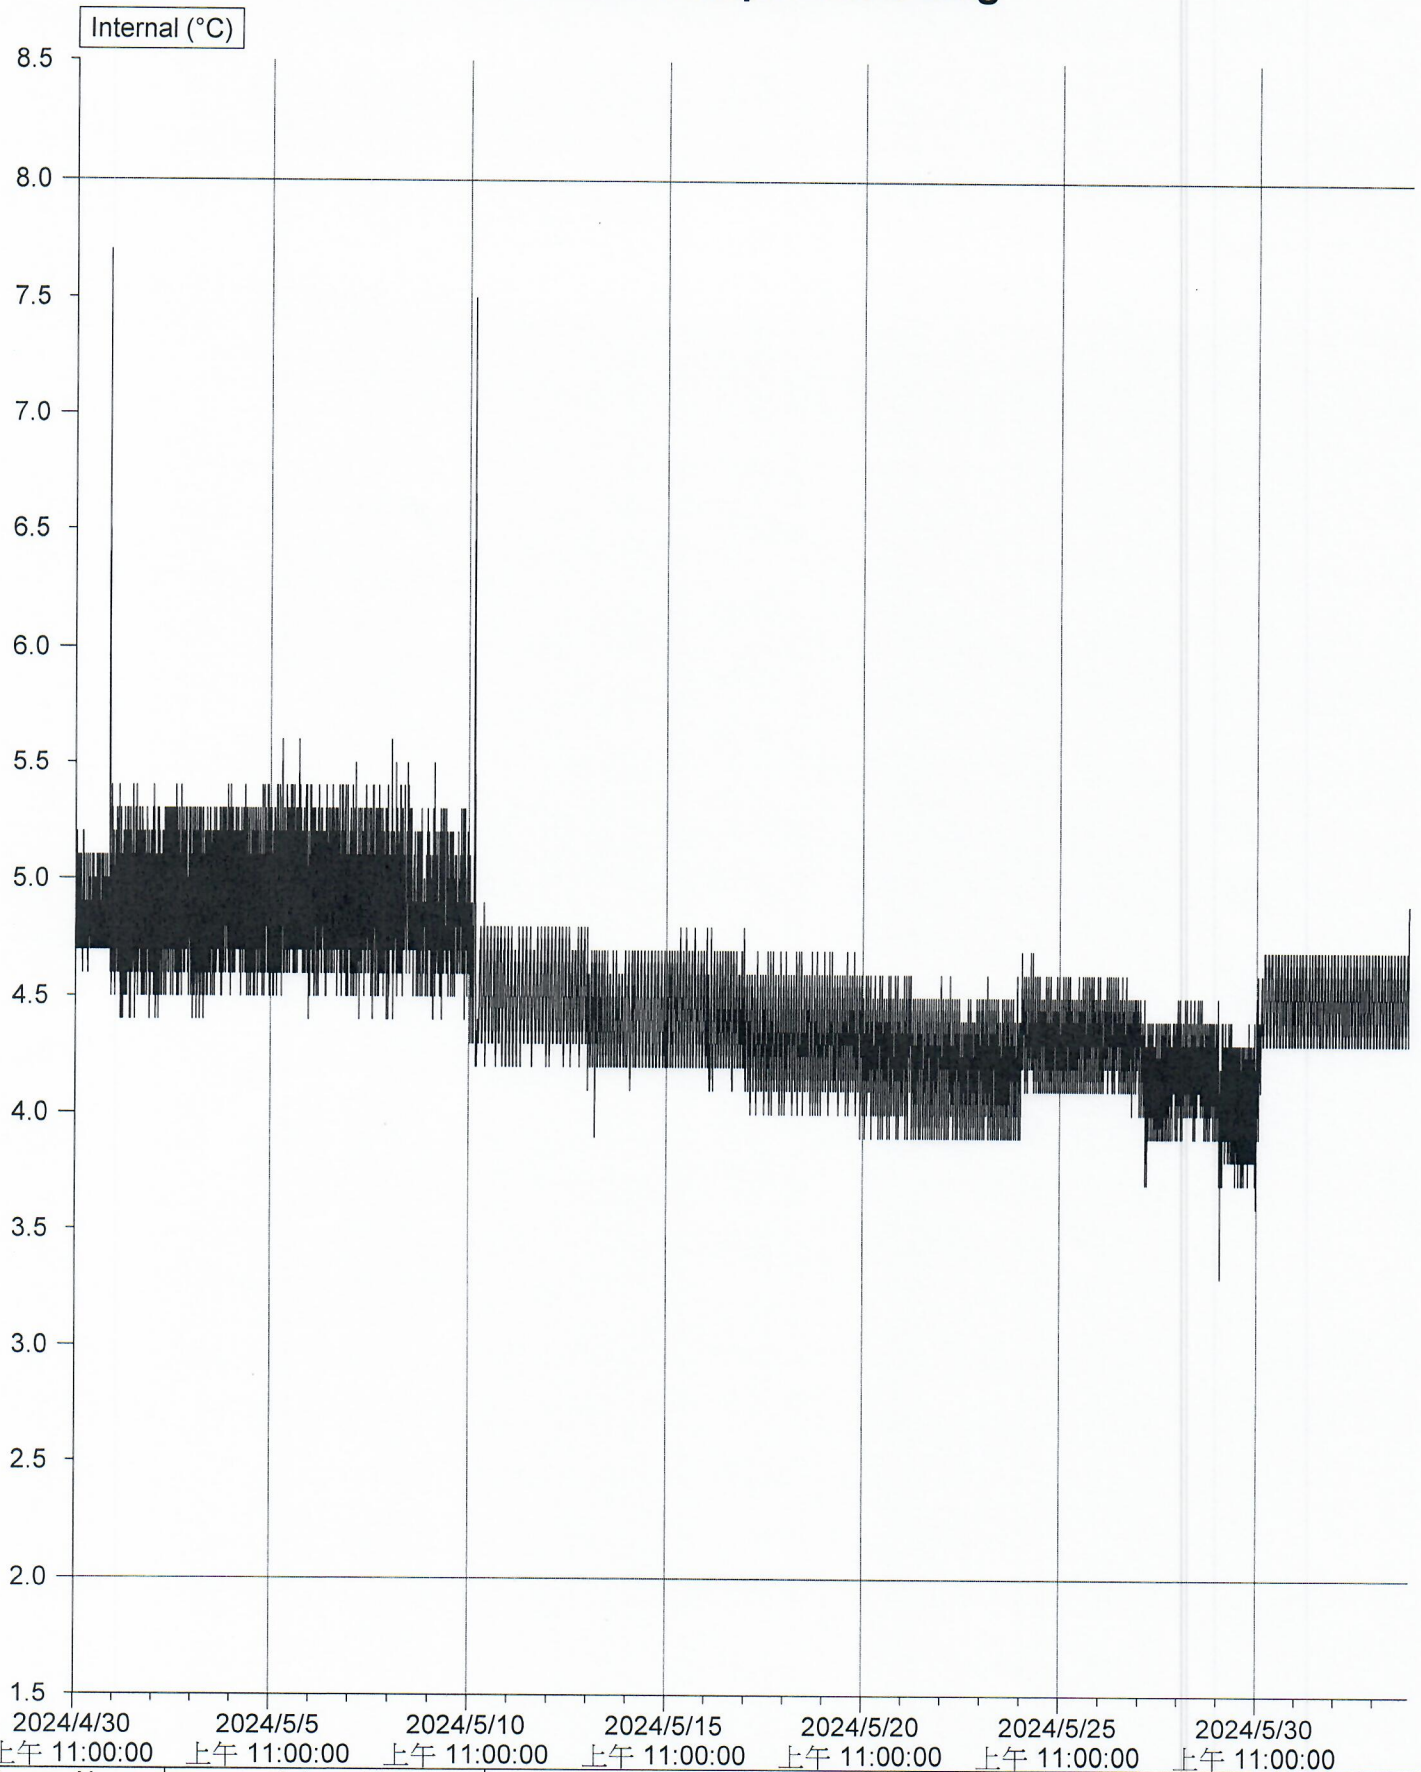

Sensor Name	Internal
Legend	
Description	PHCL-C006 / PHCL-006
Serial Number	1803-0049
Product Code	EI-IN-D-32-L
Start	2024/4/30 上午 11:00:00
Finish	2024/6/3 上午 08:30:00
Sensor Range	-40.5 to 70.4 °C
Specification	2.0 to 8.0 °C
Average	4.5 °C
Highest	7.7 °C
Lowest	3.3 °C

The continuous temperature recorder (Serial number: 1803-0049) and Investigational Products were transferred from PHCL-006 to PHCL-006 on 10 May 2024 14:00.

The refrigeration equipment PHCL-006 is now being used as a back up refrigerator.

Yuchen Su 03 Jun 2024