


TCVGH Room Temperature Log

Air Temp (°C)

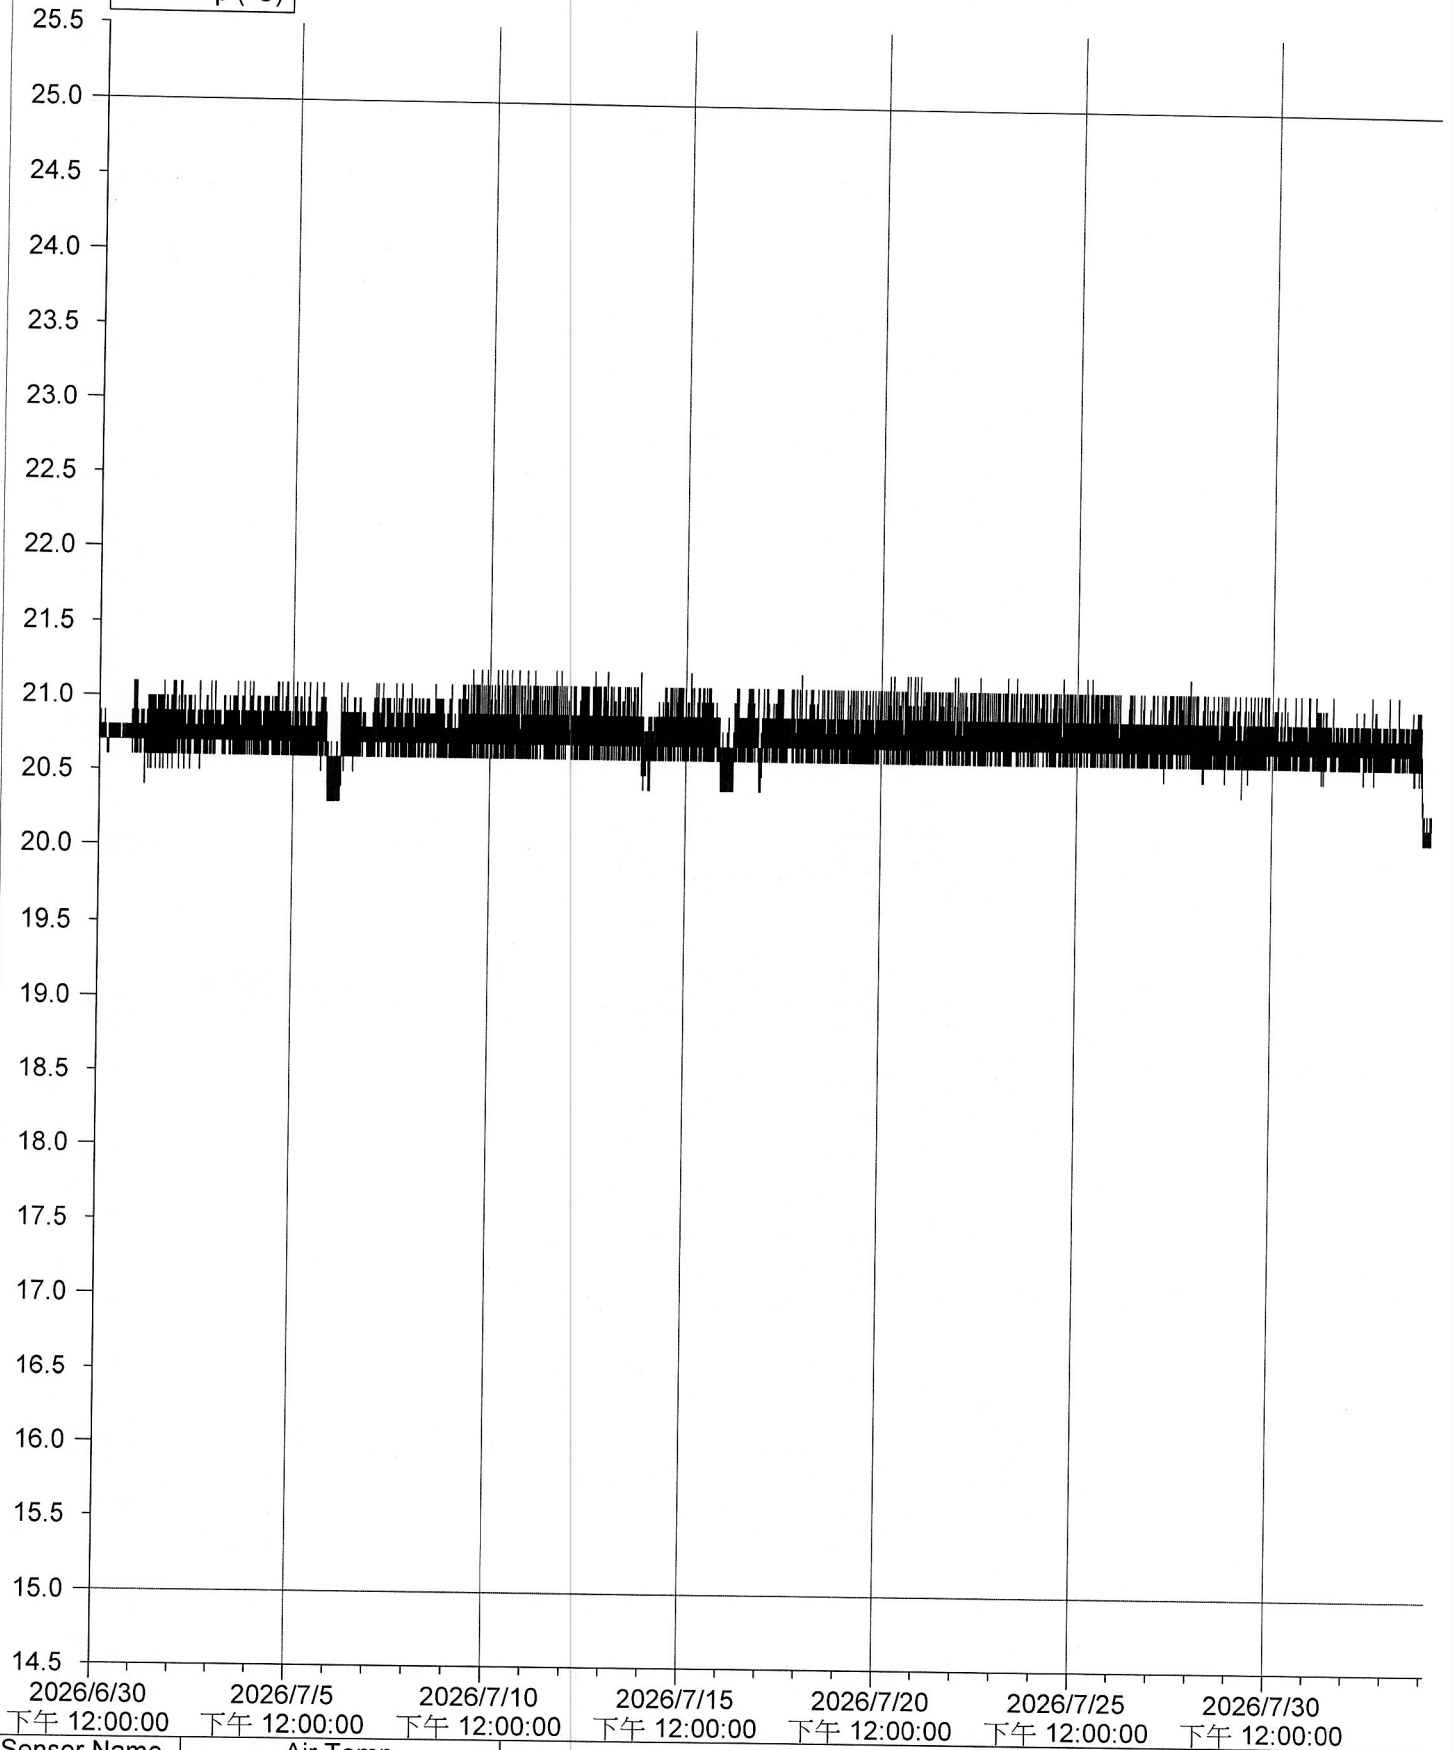

2026/6/30 下午 12:00:00 2026/7/5 下午 12:00:00 2026/7/10 下午 12:00:00 2026/7/15 下午 12:00:00 2026/7/20 下午 12:00:00 2026/7/25 下午 12:00:00 2026/7/30 下午 12:00:00

Sensor Name	Air Temp
Legend	
Description	PHCL-C021(室)
Serial Number	1333-0016
Product Code	EI-HS-D-32-L
Start	2026/6/30 下午 12:00:00
Finish	2026/8/3 下午 02:30:00
Sensor Range	-40.5 to 70.4 °C
Specification	15.0 to 25.0 °C
Average	20.8 °C
Highest	21.2 °C
Lowest	20.1 °C

Yunma
03 Aug 2026